



National Power Corporation

SUPPLEMENTAL / BID BULLETIN NO. 2022-GOODS-058

to the Bidding Documents for the:

FABRICATION OF GENERATOR AIR COOLER, AG2

MA-A2M22-042/ PB-2022-011, ITEM NO. 1)

(Published on June 15, 2022, PhilGEPS)

All prospective bidders are hereby informed of the changes in some provisions of the tender documents as follows:

Clarification:

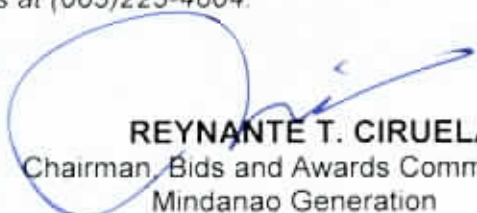
1. Section V. Special Conditions of Contract:
GCC Clause No. 4

From	To
<p><i>i. The inspections and tests that will be conducted are: Continuous hydrostatic test of at least 24 hours of the units at 150 psi and should be performed in the presence of NPC representative.</i></p>	<ol style="list-style-type: none"> 1. <i>During fabrication of the generator air cooler, the end-user and/or CMD or any authorized NPC representative shall conduct site inspection to ensure its quality.</i> 2. <i>An inspection and test shall be conducted for at least 24 hours at 1.5x the maximum test pressure or 150 psi (since working pressure is 60 psi) with the presence of the end-user and/or CMD or any authorized NPC representative to ensure the final products' quality.</i>

Notes:

1. All other terms published in the previous publication that are not amended by this publication shall remain the same.
2. For further clarification, you may contact us at (063)223-4604.

For the information and guidance of all concerned.


REYNANTE T. CIRUELA
 Chairman, Bids and Awards Committee
 Mindanao Generation

Date of Publication: June 29, 2022

NPC-009.F17
Rev No 1
Page 1 of 1

BIR Road cor. Quezon Avenue, Diliman
Quezon City 1100, Philippines
Tel. Nos. (632) 921-3541 to 80
Fax No. (632) 921-2488
Website: www.napocor.gov.ph



Management System
ISO 9001:2015
www.tuv.com
ID: 913982265

