

## National Power Corporation

### SUPPLEMENTAL/BID BULLETIN NO. 2

to the Bid Documents for the:

**LEASE OF 1.0 MW MODULAR DIESEL GENSETS FOR SAN VICENTE DPP UNDER PR NO. S1-SVD22-019 / REF. NO. PB221026-NA00398**

**27 OCTOBER 2022**

All prospective bidders and authorized copy holders of the Bid Documents of the above mentioned project are hereby advised of the changes on the provisions of the Bid Documents, to wit:

#### A. SCHEDULE OF BID OPENING/SUBMISSION

FROM	TO
POSTPONED UNTIL FURTHER NOTICE. (Supplemental/Bid Bulletin No. 1 dated 26 October 2022)	<b>03 November 2022</b> 09:30 A.M. Kanao Room

#### B. POWER PLANT LAYOUT

***Please refer to the attached POWER PLANT LAYOUT of San Vicente DPP.***

#### C. CONTACT PERSON FOR SITE VISIT

**Charles S. Damalerio**  
**Contact Number: 0908-181-8795**  
**Email Address: csdamalerio@napocor.gov.ph**

#### D. SECTION VI – TECHNICAL SPECIFICATIONS PART I CLAUSE-2.0 SCOPE OF WORKS TS-2.1 By the Lessor Item 18c.

FROM	TO
Certificate of Endorsement (COE) from DENR	Certificate of Endorsement (COE) from <b>DOE</b>



**E. SECTION VI – TECHNICAL SPECIFICATIONS PART I CLAUSE TS-1.1 Project Description  
 Deployment Schedule**

FROM	TO
20 calendar days from receipt of Notice to Proceed	60 calendar days from receipt of Notice to Proceed. It shall be understood that the deployment of generating units shall commence upon the release of the renewed/amended Environment Compliance Certificate (ECC) from the DENR. The Lessor shall not be held liable for the delays in the deployment/mobilization if the ECC will not be available within the period of 60 calendar days.

**F. SECTION VI – TECHNICAL SPECIFICATIONS PART I CLAUSE TS-1.3 Delivery/Deployment  
 Duration**

FROM	TO
The delivery, installation, testing and commissioning of the modular generating set/s shall be completed by the Lessor in twenty (20) calendar days from receipt of Notice to Proceed."	The delivery, installation, testing and commissioning of the modular generating set/s shall be completed by the Lessor in <b>sixty (60) calendar days</b> from receipt of Notice to Proceed. It shall be understood that the deployment of generating units shall commence upon the release of the renewed/amended Environment Compliance Certificate (ECC) from the DENR. The Lessor shall not be held liable for the delays in the deployment/mobilization if the ECC will not be available within the period of 60 calendar days.

All other terms and conditions shall remain the same.

For the information and guidance of all authorized copy holders of the Bid Documents and prospective bidders.

For the Bids and Awards Committee:


  
**RENE B. BARRUELA**  
 Vice President, Corporate Affairs Group and  
 Chairman, Bids and Awards Committee



Management System  
 ISO 9001:2015  
 www.tuv.com  
 ID 910665265



49890

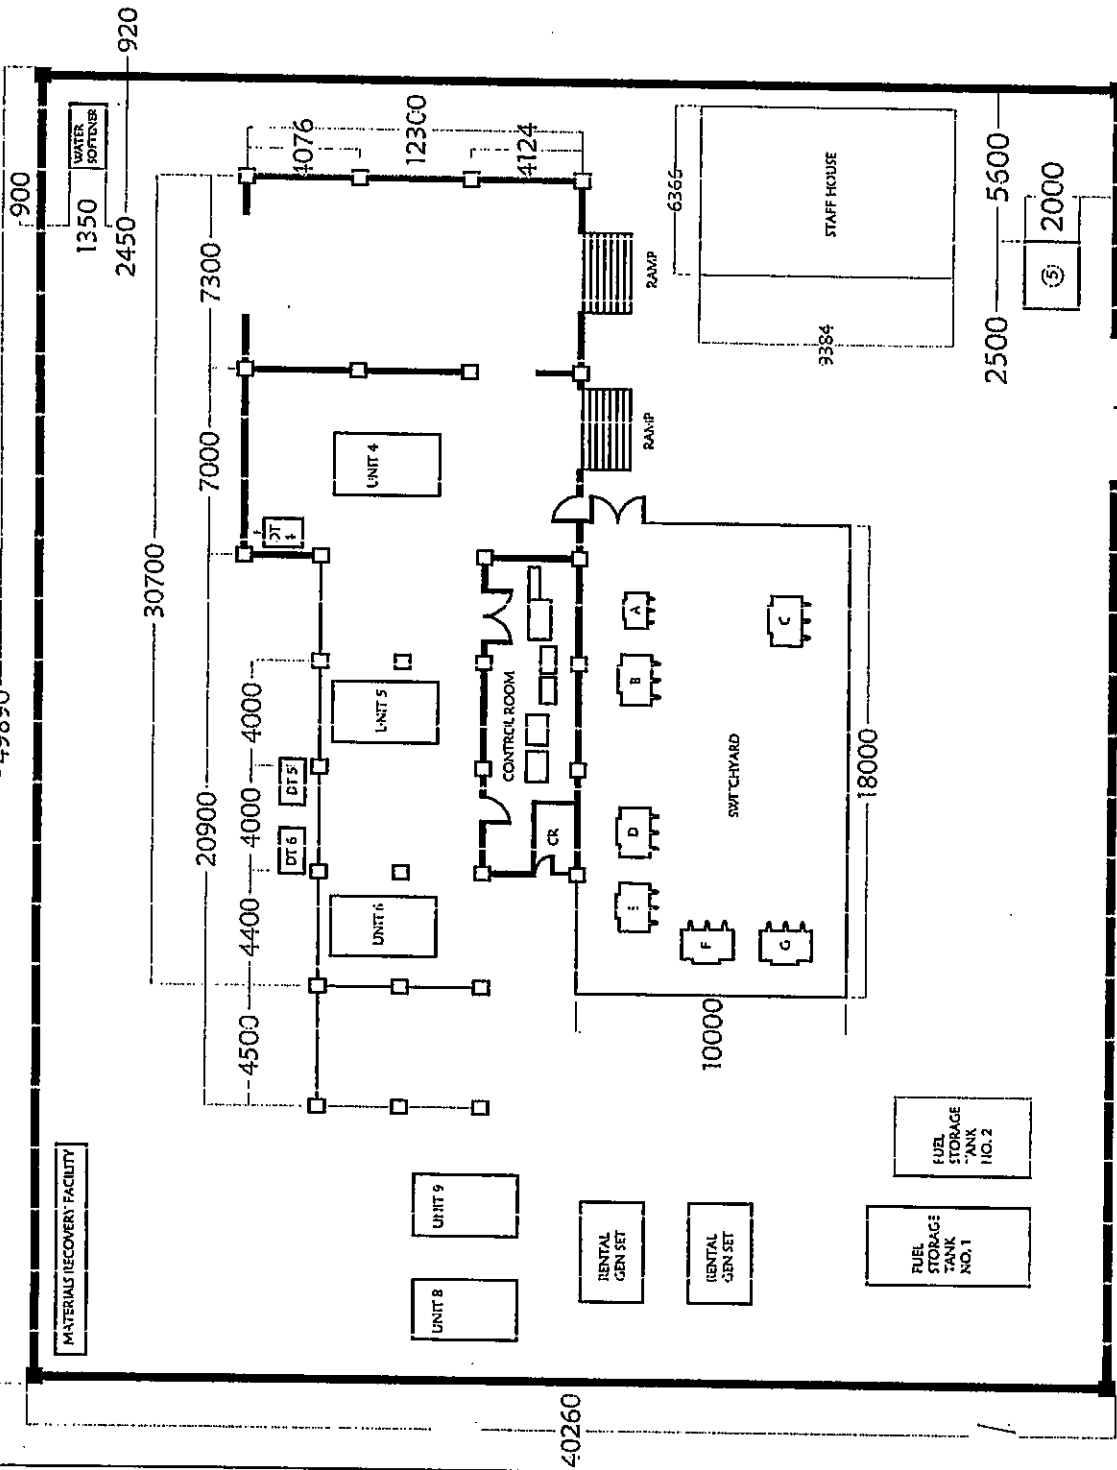

NOTES:

- UNIT 4: 500 KW, MAIN CXZ, OPERATIONAL
- UNIT 5: 600 KW, CUMMINS, OPERATIONAL
- UNIT 6: 600 KW, CUMMINS, UNDER CORRECTIVE MAINTENANCE
- UNIT 8: 600 KW, CUMMINS, OPERATIONAL
- UNIT 9: 600 KW, CUMMINS, OPERATIONAL

LEGEND:

- A: Y-Δ, 75 KVA, 3Φ TRANSFORMER
- B: Δ-Y, 400 KVA, 3Φ TRANSFORMER
- C: Δ-Y, 400 KVA, 3Φ TRANSFORMER
- D: Δ-Y, 225 KVA, 3Φ TRANSFORMER
- E: Δ-Y, 700 KVA, 3Φ TRANSFORMER
- F: Δ-Y, 750 KVA, 3Φ TRANSFORMER
- G: Δ-Y, 750 KVA, 3Φ TRANSFORMER



**NATIONAL POWER CORPORATION**  
 SMALL POWER UTILITIES GROUP  
 LUZON OPERATIONS DEPARTMENT  
 PALAWAN AREA OPERATIONS DIVISION

DRAFTED	J. FERNANDEZ SR. ENGINEER	PLANT LAY-OUT
RECOMMENDED	RODRIGO M. VALERIO PLANT HEAD / E.O.	SAN VICENTE DIESEL POWER PLANT BRGY. NEW AGUTAYA, SAN VICENTE, PALAWAN
APPROVED	F. E. BARRIOS MANAGER, P.O.	DATE: AUGUST 05, 2023 REVISION: 1 DRAWING NUMBER: PDD-SVJL-004
		SHEET 1 / 1

⊕ SAN VICENTE DPP EQUIPMENT PLANT LAY-OUT  
 SCALE: 1:300

⊕ DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED